

Installation Instructions

RF000179 Package Unit Door Gasket Kit

Description

The RF000179 gasket kit is to be used on all Large 36" and Small 30" Chassis Cooling and Heat Pump units. The gasket kit is designed to minimize outdoor ambient air infiltration into the conditioned air compartments of the unit.



WARNING

To avoid property damage, personal injury or death due to electrical shock, disconnect the electrical power supply before servicing this unit. Some models will have two power sources, so be certain to disconnect both power sources. This may include the indoor unit as well as the outdoor unit.

Contents of Package Unit Door Gasket Kit:

Qty	Part #	Description
17'	10839803	Gasket Material
1	RF000178	Installation Instructions



WARNING

Disconnect all power before servicing unit.

Installation Procedures:

1. Disconnect electrical power to the unit.
2. Remove the screws (2 per door) that secure the blower, control and evaporator access panel doors to the unit and then remove each access panel door.
3. Next, cut six strips of gasket material 26.5" in length for small chassis units or 32.5" in length for large chassis units (Refer to Figure 1 on Page 2), and then attach one piece of the gasket material to each inside flange of the blower, control and evaporator access panel doors (Refer to Figure 2 on Page 2). **Note:** Two pieces of gasket material will be used per access panel door.
4. Reinstall the blower, control and evaporator access panel doors using the screws (2 per door) that were previously removed in Step 2 above.
5. Restore power to unit.
6. Verify the system is functioning correctly in each mode of operation.



RECOGNIZE THIS SYMBOL AS A SAFETY PRECAUTION

ATTENTION INSTALLING PERSONNEL

As a professional installer you have an obligation to know the product better than the customer. This includes all safety precautions and related items.

Prior to actual installation, thoroughly familiarize yourself with this Instruction Manual. Pay special attention to all safety warnings. Often during installation or repair it is possible to place yourself in a position which is more hazardous than when the unit is in operation.

Remember, it is your responsibility to install the product safely and to know it well enough to be able to instruct a customer in its safe use.

Safety is a matter of common sense...a matter of thinking before acting. Most dealers have a list of specific good safety practices...follow them.

The precautions listed in this Installation Manual are intended as supplemental to existing practices. However, if there is a direct conflict between existing practices and the content of this manual, the precautions listed here take precedence.

SMALL CHASSIS - 26.5" EA STRIP
LARGE CHASSIS - 32.5" EA STRIP

ADHERE GASKET TO BOTH SIDE FLANGES OF DOORS

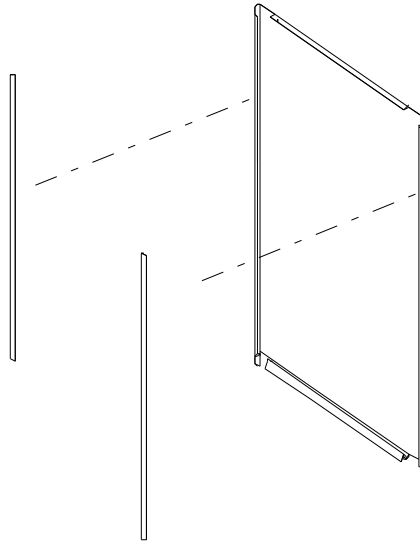


Figure 1

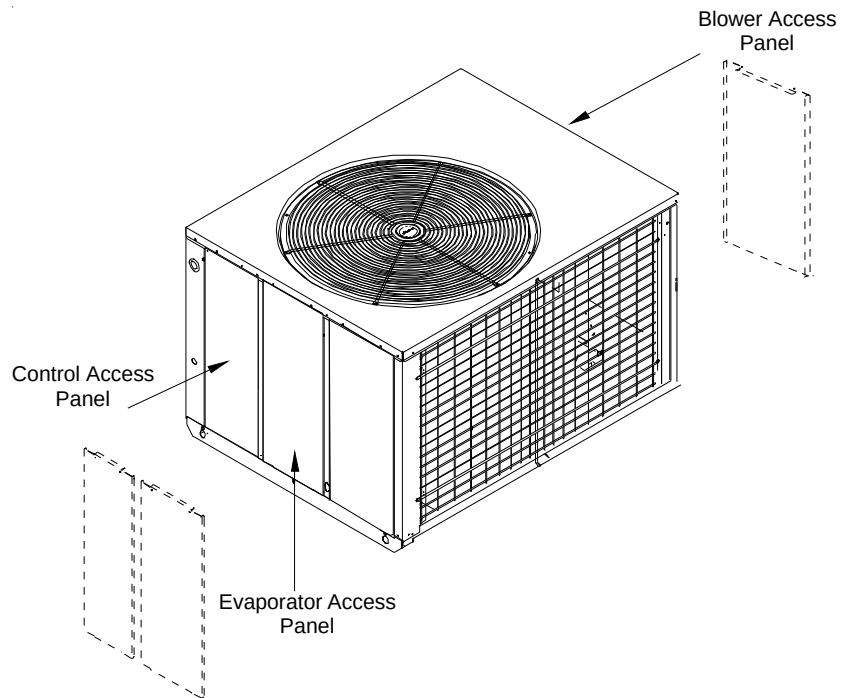


Figure 2

Amana is a trademark of Maytag Corporation and is used under license to Goodman Company, L.P.

All rights reserved.

©2004 Goodman Company, L.P.